

8-STAGE Alkaline Water System

Antares
APOLLOTEK
INTERNATIONAL **PRO**

1 PP Sediment 5 micron

- Removes suspended particles and large colloids larger than 5 micron
- Removes moss
- Material: Polypropylene

• Recommended changing: ~ 6 months

2 Granular Activated Carbon

- Removes chlorine and some organic molecules.
- Protects R.O. membrane from oxidants
- Material: Activated carbon

• Recommended changing: ~ 9 months

3 Quick changing RO membrane 100GPD

- Filter hole size from 0.1 - 0.5 nanometers, removes almost all colloids, microbiological contaminants, organic molecules, salts, and viruses, resulting in clean refreshing water
- Material: Thin film composite

• Recommended changing: ~ 24 - 36 months

4 Alkaline filter

- Makes water taste fresh.
- Increases pH up to 10
- Material: Corosex.

• Recommended changing: ~ 12 months

5 T33 Granular Activated Carbon

- Makes water taste fresh
- Removes organic solids, colors, and odor
- Material: Coconut shell activated carbon

• Recommended changing: ~ 12 months.

6 Mineral

- Supplements necessary minerals for the human body
- Raises the pH, helping neutralize surplus acids and making the body healthier
- Makes water taste better

• Recommended changing: ~ 12 months

3 Alkaline Cartridges for better results and taste

7 Far Infrared

- Emits far infrared rays to active water, helping water to be absorbed into blood easier
- Material: Bio-ceramic ball


• Recommended changing: ~ 9 months

8 Nano Silver

- Kills bacteria and prevents intrusion into the water by 99.99%
- Material: Coconut Activated Carbon covered by Nano Silver


• Recommended changing: ~ 12 months

SERVING OVER
125,000
CUSTOMERS

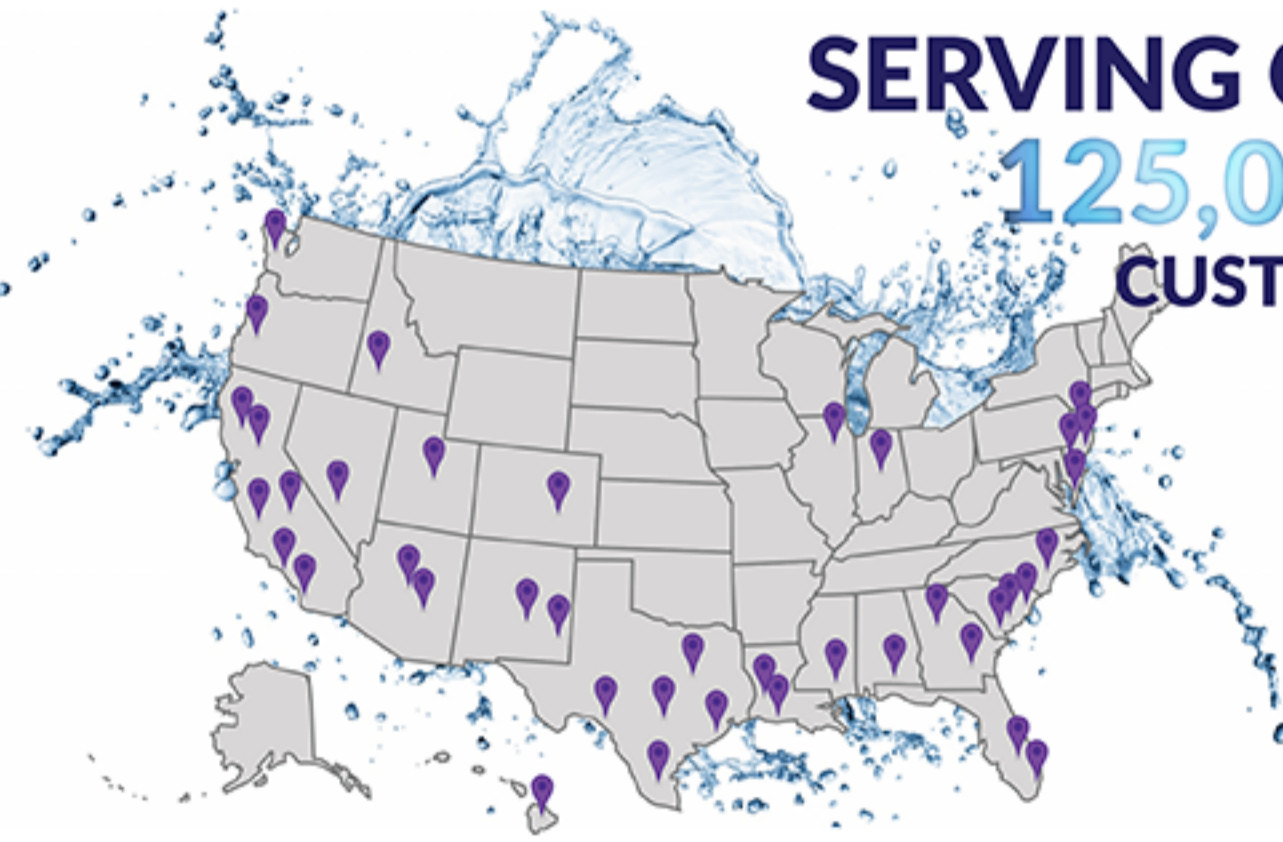

ARIZONA CALIFORNIA FLORIDA GEORGIA HAWAII IDAHO ILLINOIS INDIANA LOUISIANA
MARYLAND NEVADA NEW JERSEY NEW MEXICO NEW YORK NORTH CAROLINA
OREGON PENNSYLVANIA SOUTH CAROLINA TEXAS UTAH WASHINGTON

PH CHART

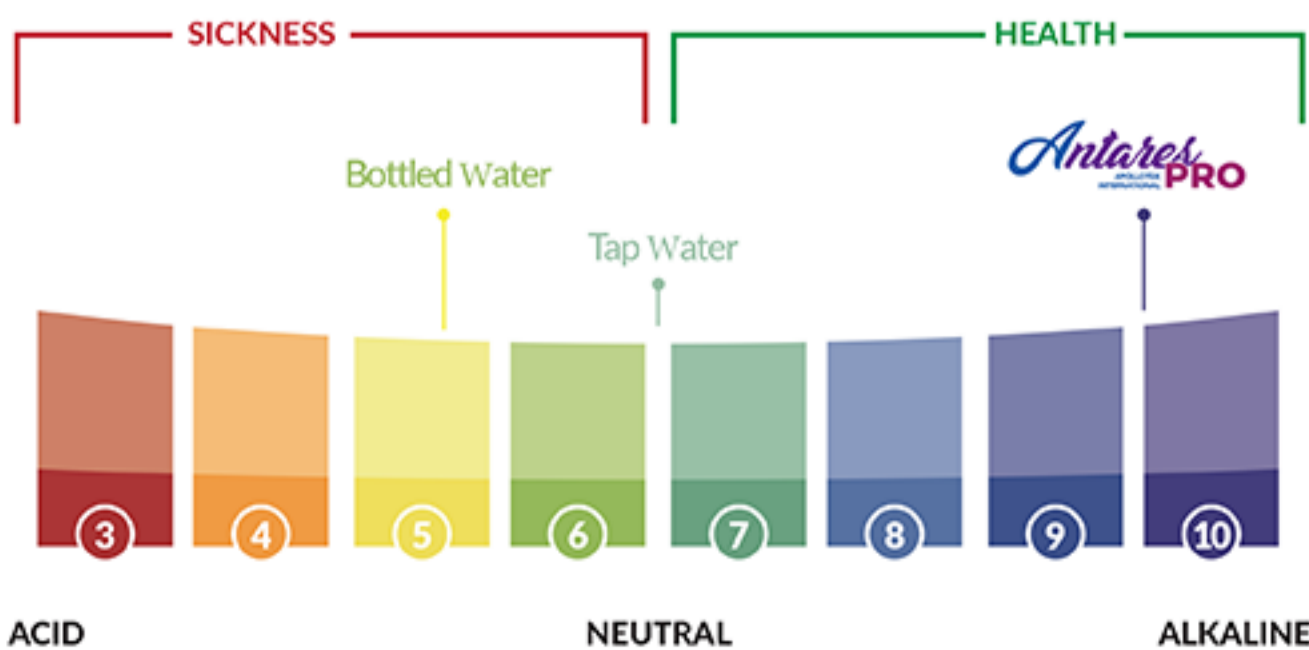

Antares
APOLLOTEK
INTERNATIONAL **PRO**

Alkaline Up to 10
ORP down to -750

8-STAGE Alkaline Water System



**SUPERIOR
DESIGN**